


Labels : Signs

PAT Testing Labels

50 x 25mm labels, supplied in rolls of 500.



✳ 50 x 25 SAV R3020.500




✳ 50 x 25 SAV R3021.500

Door Labels



Ⓜ 150 x 150 SAV 13876




Ⓜ 150 x 150 SAV 13877



Ⓜ 150 x 150 SAV 13878

Maintenance Labels

These PAT testing labels are printed on self adhesive paper, allowing you to write the correct compliance details directly onto the label. Supplied in sheet format.



80 per sheet


✳ 51 x 15 SAP 3250



80 per sheet

✳ 51 x 15 SAP 3300

Printed on self adhesive vinyl allowing you to write the correct compliance details directly onto the label. Supplied in sheet format.

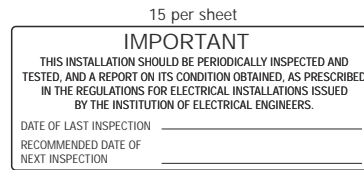

15 per sheet

✳ 96 x 38 SAV 2950

Electrical Label Sheets



56 per sheet

✳ 49 x 20 SAV 3006



56 per sheet

✳ 49 x 20 SAV 3001



56 per sheet

✳ 49 x 20 SAV 3007



56 per sheet

✳ 49 x 20 SAV 3004



56 per sheet

✳ 49 x 20 SAV 3005



56 per sheet

✳ 49 x 20 SAV 3002



15 per sheet

✳ 96 x 38 SAV 3060




15 per sheet

✳ 96 x 38 SAV 3051




15 per sheet

✳ 96 x 38 SAV 3052



15 per sheet

✳ 96 x 38 SAV 3058



15 per sheet

✳ 96 x 38 SAV 3059




15 per sheet

✳ 96 x 38 SAV 3053



15 per sheet

✳ 96 x 38 SAV 3054



15 per sheet

✳ 96 x 38 SAV 3150

Harmonised Electrical Labels

Electrical installation work must now use the new harmonised cable colours or the pre-existing colours, but not a mix of the two. All labels are printed on weather resistant vinyl and supplied on a sheet.

184 labels per sheet

Existing		New (Harmonised)	
L1	L1	L1	L1
L2	L2	L2	L2
L3	L3	L3	L3
N	N	N	N

Sheet contents:
 1 colour set of 40mm x 120mm
 2 colour sets of 10mm x 69mm
 4 colour sets of 5mm x 69mm
 16 colour sets of 3mm x 33mm

✳ Various SAV 3400

12 per sheet



✳ 95 x 45 SAV 3402

12 per sheet



✳ 95 x 45 SAV 3401

New Build Installations

In these cases an appropriate label should be placed next to the distribution board or consumer unit to notify any future electricians of the standard used.

Extensions or alterations to existing installations

When extending or altering an existing installation (using the old cable colours) with wiring of the new harmonised type, you do not have to notify this at each interface between the two - although this is recommended.

However a label should be affixed to the distribution board or consumer unit.